


**Enumclaw Fire Department**  
1330 Wells Street  
Enumclaw, WA 98022  
Phone 360-825-5544  
Fax 360-825-9442



## **Fire Department Connection Detail**

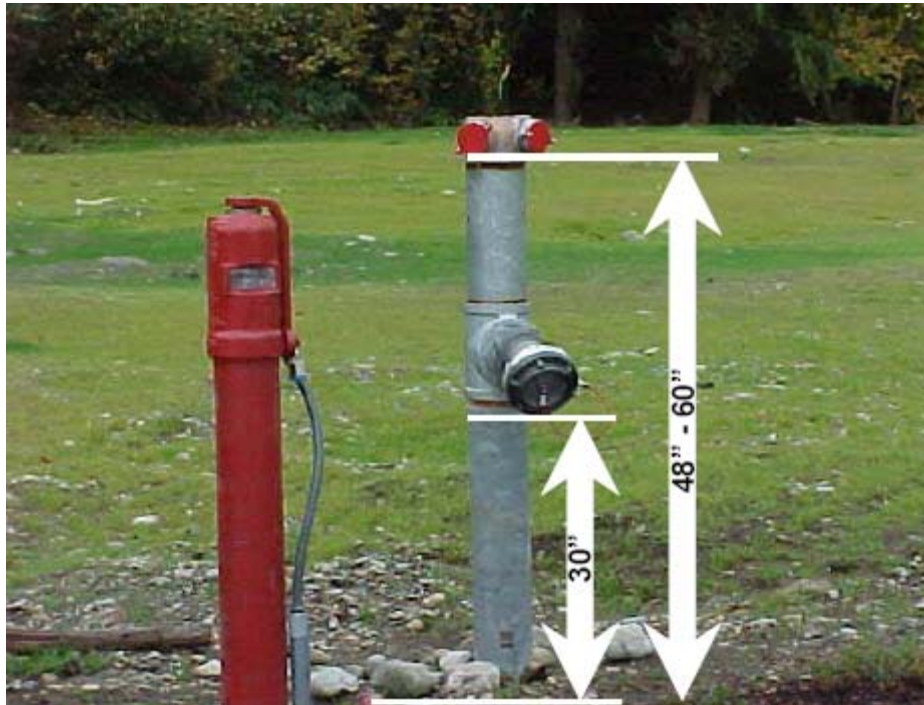

1. 4" Storz connection auto sprinkler connection set 30" above grade. Outlet to be protected with a locking Storz Cap Model 3000.
2. 2 ½" NST Siamese auto sprinkler connection set 48"-60" above grade. Outlets to be protected with locking Storz Cap Model 3010.

**Storz FDC caps can be ordered online at [www.knoxbox.com](http://www.knoxbox.com)**